


The next two maps outline properties using two different wells for two separate standalone water delivery systems.

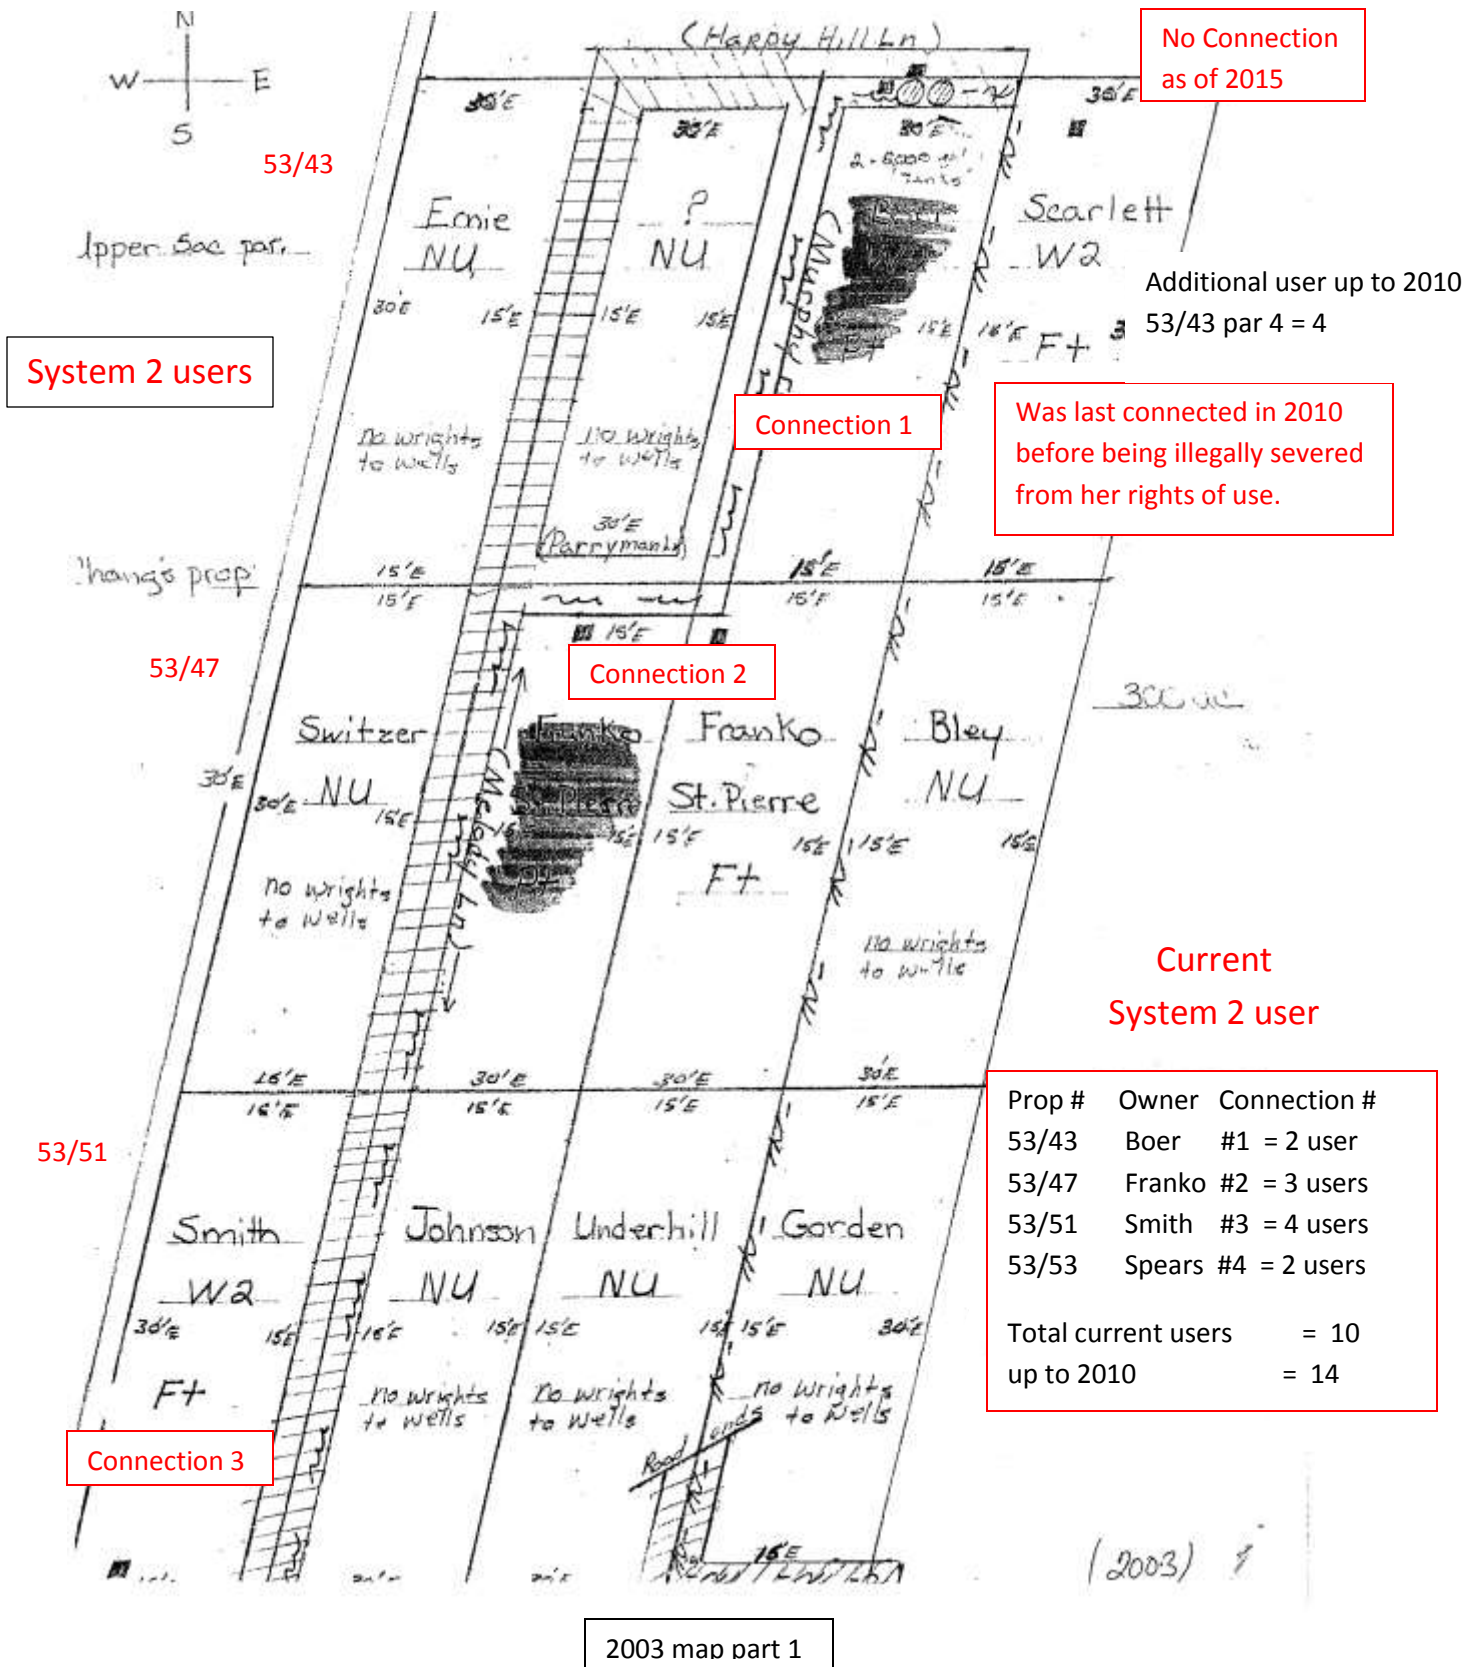


The green outlines are legally entitled service connections using their 1992 grant of easement rights.

This is an accurate description 2003 to 2014.

System 2 user


Connection 4

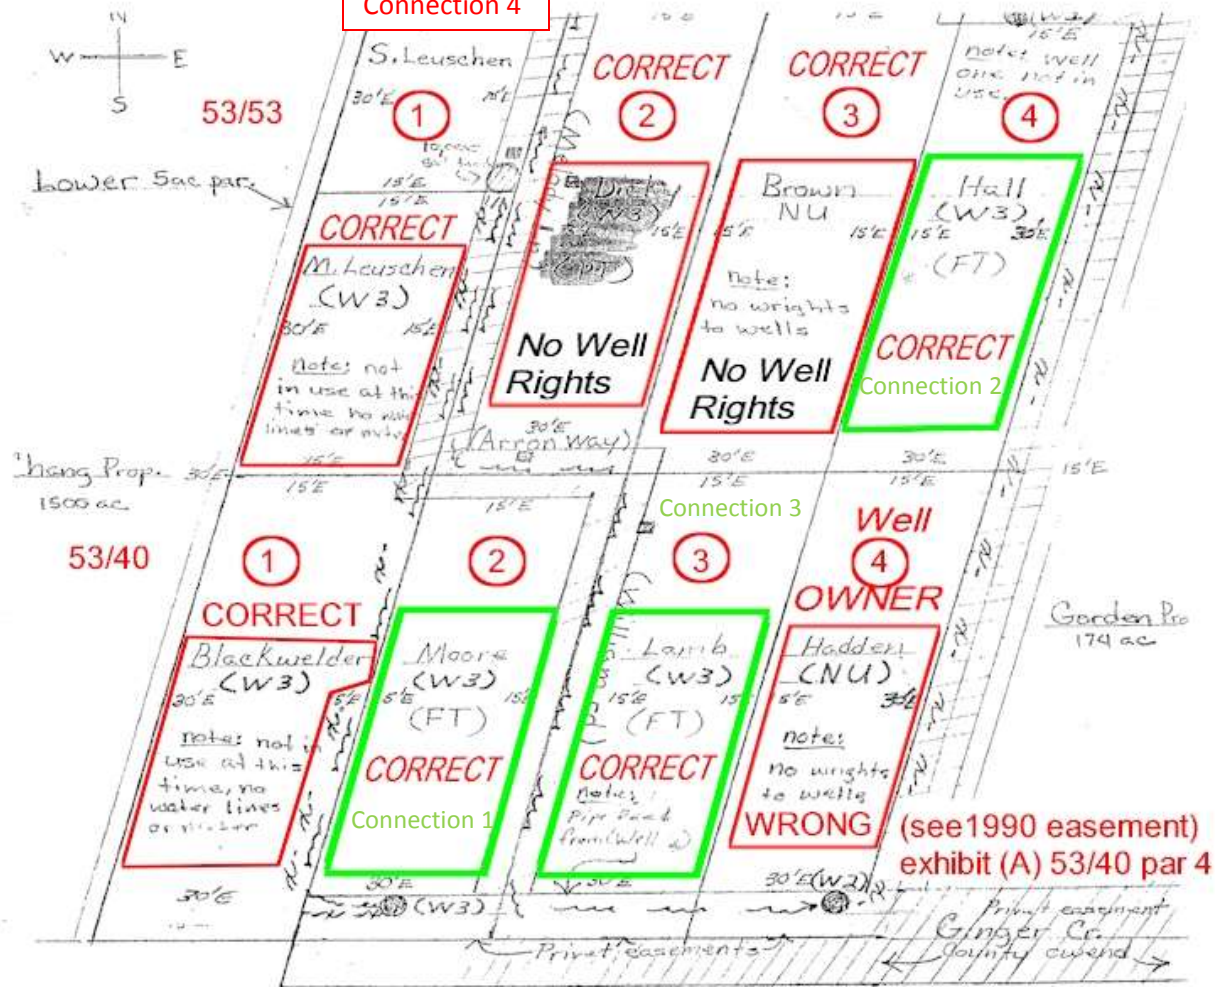

This map without the color outlines is on file within DEH records.

The black and white map was provided to me by Riverside Environmental Health.

This is a copy of the south ½ of the original 2003 MAP that is on file with DEH.

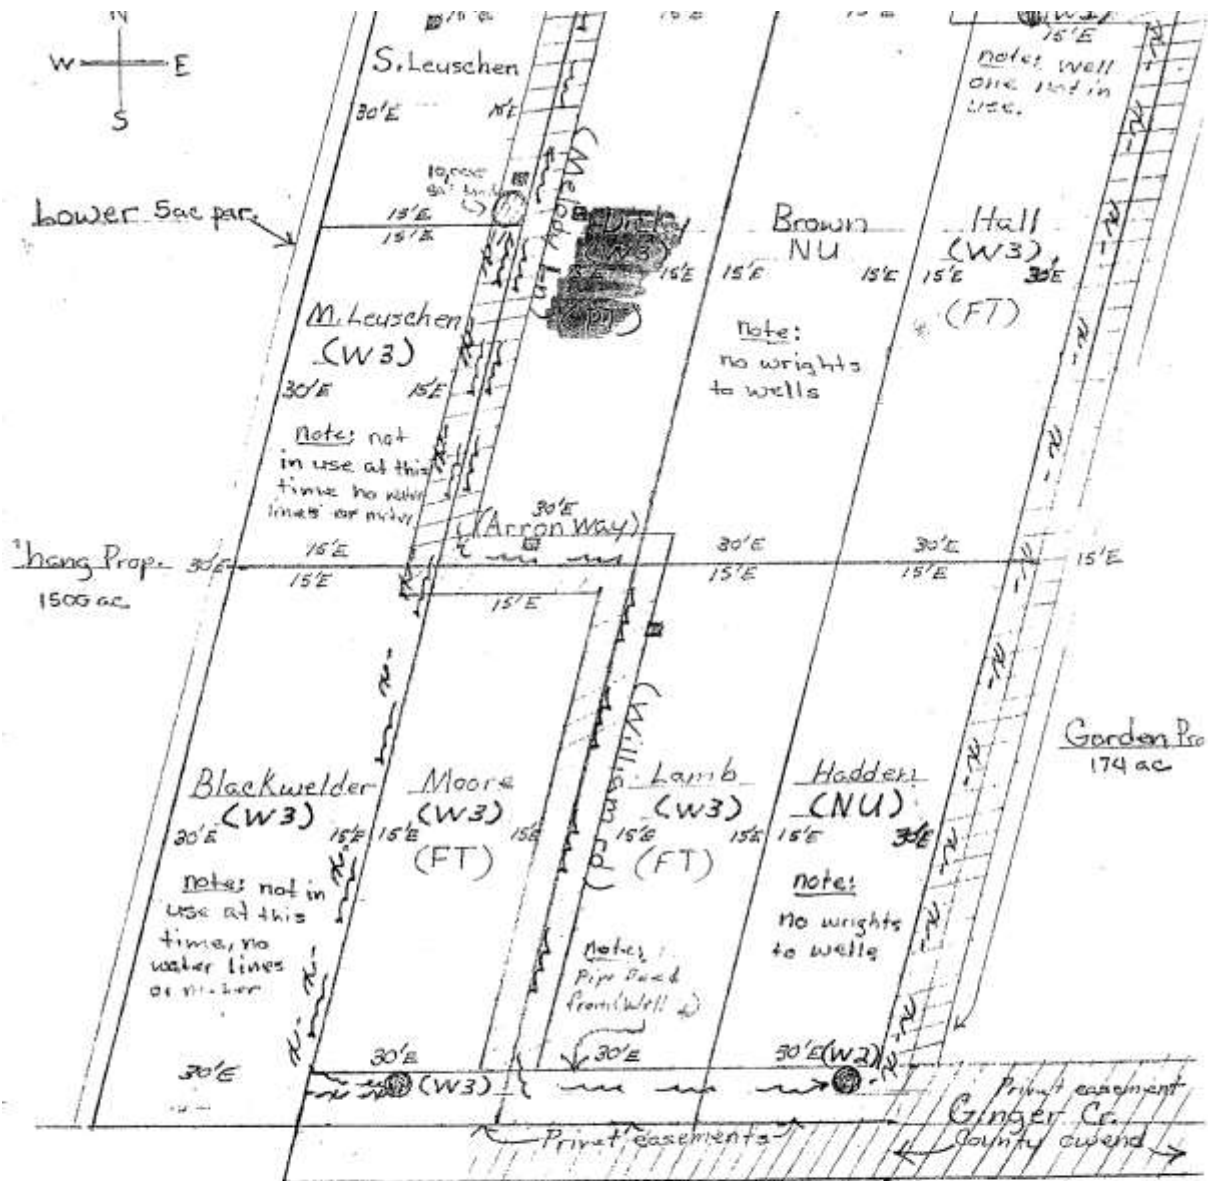

Note: ~~ONE~~ ^{WATER} return lines are not shown. Properties show what well they are on.

Loupez Prop.

Note: Roads do not follow easements ext.

1" = 30' Easement

$\frac{1}{2}'' \text{ cm} = 15' \text{ Exaggeration}$

(2005)

F+	Full time users		Roads
P+	Part time users	NU	None Users

	Main water lines
-V	Automation Lines
①	Water holding tanks
●	Wells (w1)(w2)(w3)
Ⓜ	Meters
⊗	Bleeder valves
	Roads
NU	None Users

Look at the map as shown above and do the math. There are two separate systems.
I did not draw that 2003 map. I am pointing out the facts on the map and how they are related to the lies being told to DEH.

My well supplied the following 3 household's water, Jeff, Maria, Tia and Jett Hall 53/53 par 4 = 4
Allen and Daniella Lamb 53/40 par 3 = 2
Greg, Sherry and Dalton Reed 53/40 par 2 = 3
2006 to 2012 Total users = 9

Emergency/Disaster Response Plan
This template is recommended for California public water systems that serve less than 1,000 service connections (or population less than 3,300).

Water System Name: Weber Valley Heights Assn.
Water System ID No: 1790
Number of Service Connections: 12 - 6 per well This was a lie.
Population Served: 24 - 12 per well This was made up.
6 - full time - 4 part time - 2 no hook-ups
See the maps above.
To continue minimum service levels and mitigate the public health risks from drinking water contamination that may occur during a disaster or other emergency events and in order to provide reliable water service and minimize public health risks from unsafe drinking water during those events, the [insert water system name] water system proposes the following plan that defines how it will respond to emergencies and/or disasters that are likely to affect its operation.

Disasters/emergencies that are likely to occur in the water system's service area that are addressed are: earthquake, major fire emergencies, water outages due to loss of power, localized flooding, water contamination, and acts of sabotage.

- DESIGNATED RESPONSIBLE PERSONNEL:** For designated responsible personnel and chain of command and identified responsibilities, see the attached table "Water System Emergency /Disaster Personnel and Responsibilities".
- INVENTORY OF RESOURCES:** An inventory of system resources that are used for normal operations and available for emergencies; includes maps and schematic diagrams of the water system, lists of emergency equipment, equipment suppliers, and emergency contract agreements that are kept at the water system office.
- EMERGENCY OPERATIONS CENTER:** The water system office has been designated as the communication network emergency operations center. Emergency contact information for equipment suppliers is attached. The telephone and FAX will be the primary mode of communication in an emergency.

Agency	Address, City	Phone #	FAX #
Water System (Primary Site)	44350 Benton Rd Hemet	767 (Deer) 2483	NONE
Water System (Alternate Site)	NONE		
Fire Department	Sage Fire Dept Sage Rd Hemet		
Law Enforcement	Riv. City Sheriff		

Using the TLMA, try finding 44350 Benton Rd. It is a fake address and only a mail box on Sage Rd.

People who lie often forget what they said or in this case it was what was written.

410, "Direct evidence" means evidence that directly proves a fact, without an inference or presumption, and which in itself, if true, conclusively establishes that fact. The statement above of 44350 Benton was in fact not a true Water system (primary site)

Look at the maps above. There is no way this could have been true.

She may not have known this map existed.

The number of connections as shown on both parts of the map is equal to 9 in total.

The statement to the left is wrong.

In 2006 there were 12 connections according to Mrs. Deborah St Pierre. In this document she changed the number of connections to 3 per separate well system. The truth is 3 households are connected to my well thereby making it a small private system as I have always claimed.

RECEIVED
AUG 02 2010

County of Riverside - Environmental Health Department
ENVIRONMENTAL HEALTH DEPARTMENT
UNSAFE & WATER EXCESSIVE PROBLEM

all corrections will be made
as soon as possible.

WA0000287

7-23-2010

Greg, (WEBER VALLEY HEIGHTS)

Thank you for the information
you sent.

The address for Weber Valley
Heights Assn is 44350 Benton Rd
Hemet Ca 92544.

As I was reading thru, I came
across the Calif Health & Safety
Code Section 116275. It states
to be a Public Water System consists
of 15 or more service connections
or service to 25 individuals daily.

We don't fit in that category.

We have 2 systems that are
separate. only 3 full times on
Top System, & 03 full Time on
Bottom System, Total of 6 users
full Time. There are 6 individuals
on the top system and 8 individuals
on the Bottom system.

all together we have 3 full
times on top & 3 non-residents.

on Bottom system we have 2 non
hook ups - 1 non resident and 3
full Times.

All of your information states
the same about 15 connections.
We've already paid for this year, so we'll
stay, But next year we be on
our own again.

Thanks
Deborah St Pierre
President



State of California—Health and Human Services Agency
Department of Health Services



DIANA M. BONTA, R.N., Dr. P.H.

ARNOLD SCHWARZENEGGER
Governor

Do a TLMA check for 44350 Benton Rd. No such physical location or address exists.

WATER QUALITY EMERGENCY NOTIFICATION PLAN

Name of Utility: Weber Valley Heights Assn.

Physical Location/Address: 44350 Benton Rd Hemet

The following persons have been designated to implement the plan upon notification by the State Department of Health Services that an imminent danger to the health of the water users exists:

Water Utility: Contact Name & Title	Email Address	Day	Telephone	
			Evening	Cell
1. <u>Deborah St Pierre Pres</u>	<u>None</u>	<u>767-0483</u>		
2. <u>Jeff Hall Vice Pres</u>	<u>None</u>	<u>767-7072</u>		
3. <u>At that point in time the title was a fraud.</u>				

The implementation of the plan will be carried out with the following State and County Health Department personnel:

State & County Health Departments: <u>Riverside</u> Contact Name & Title	Telephone	
	Day	Evening
1. DE Name, District Engineer California Department of Health Services	(XXX) XXX-XXXX	(XXX) XXX-XXXX
2. Alternative CDHS Staff California Department of Health Services	(XXX) XXX-XXXX	(XXX) XXX-XXXX
3. County Environmental Health Department Local Primacy Agency	(XXX) XXX-XXXX	(XXX) XXX-XXXX

4. If the above personnel cannot be reached, contact:

Office of Emergency Services Warning Center (24 hrs) (800) 852-7550 or (916) 845-8911
When reporting a water quality emergency to the Warning Center, please ask for the California
Department of Health Services – Drinking Water Program Duty Officer.

NOTIFICATION PLAN

Attach a written description of the method or combination of methods to be used (radio, television, door-to-door, sound truck, etc.) to notify customers in an emergency. For each section of your plan give an estimate of the time required, necessary personnel, estimated coverage, etc. Consideration must be given to special organizations (such as schools), non-English speaking groups, and outlying water users. Ensure that the notification procedures you describe are practical and that you will be able to actually implement them in the vent of an emergency. Examples of notification plans are attached for large, medium and small communities.

Report prepared by:

Deborah St Pierre Pres.
Signature and Title

6.21.07
Date

Another lie, her claim to fame was from 2004 to 2006. The association was defunct on 6-21-07.
At this point in time her true title was past president elect.

Last Updated — 12/23/03

Mrs. Deborah St Pierre's term in office had expired at midnight on 9-11-2006. See the 2004 election results, it was for a two year term according to the 2002 bylaws.